



1. LETTERING SHALL APPEAR ON 3 SIDES OF THE PIPE AND RUN THE ENTIRE LENGTH OF THE PIPE.
2. LETTERING SHALL BE A MIN. OF 3/4" IN HEIGHT AND APPEAR ONE OR MORE TIMES EVERY 21" ALONG THE LENGTH OF THE PIPE.
3. LETTERING MUST BE PERMANENTLY IMPREGNATED INTO THE PVC (IT MAY NOT BE STENCILED TO THE PIPES SURFACE).
4. LETTERING SHALL BE WHITE OR OTHER CONTRASTING COLOR.

### PVC RECLAIMED WATER MAIN


NTS

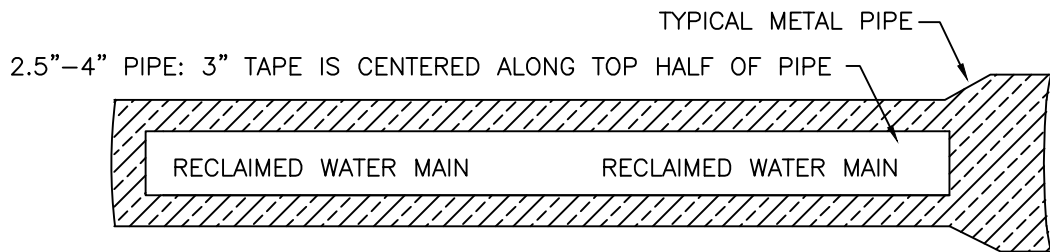

6'-16" PIPE: 6" TAPE IS PLACED ALONG BOTH SIDES OF THE TOP HALF OF PIPE

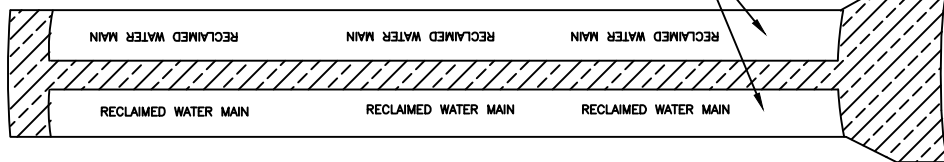

18" AND LARGER PIPE: TAPE IS PLACED ON BOTH SIDES OF TOP HALF OF PIPE WITH A THIRD STRIP CENTERED ALONG TOP HALF OF PIPE

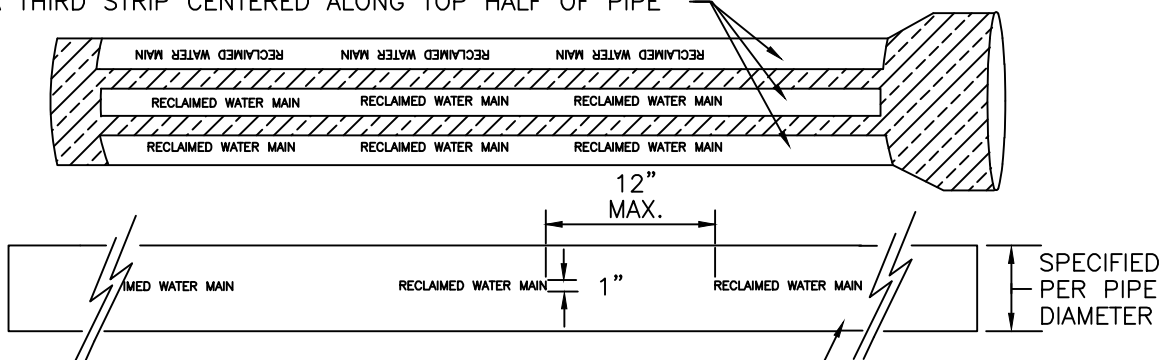

PURPLE TAPE WITH WHITE OR OTHER CONTRASTING PERMANENTLY IMPREGNATED LETTERING SHALL BE USED. THE TAPE SHALL RUN FROM JOINT TO JOINT ALONG THE LENGTH OF THE PIPE.

### DUCTILE IRON RECLAIMED WATER MAIN WITH AFFIXED IDENTIFICATION TAPE

NTS

TYPICAL PIPE IDENTIFICATION  
(RECLAIMED WATER SHOWN AS EXAMPLE ONLY)